

Casablanca[®]

millelumen[®]

TET

- Ⓓ Elektrische Anschlüsse dürfen nur vom Elektrofachmann ausgeführt werden.
- ⒼⒷ Electrical connections may be carried out by professional electricians only.
- Ⓕ Les raccordements électriques doivent être effectués uniquement par un électricien qualifié.
- Ⓘ L'apparecchio d'illuminazione è sicuro solo se installato da personale qualificato.
- ⒫ Podłączenia elektryczne mogą zostać wykonywane tylko przez elektryków.
- Ⓔ La instalación debe realizarse por personal cualificado.
- ⒲ *электрические соединения могут осуществляться только профессиональным электриком.*




TET

LED Austausch - Replacement Échange - Scambio - Intercambio


Casablanca®
millelumen®



1 Zuerst Leuchte vom Stromnetz trennen
Disconnect the luminaire from power supply
Débranchez le luminaire de l'alimentation électrique
Scollegare l'apparecchio dall'alimentazione
Desconecte la luminaria de la fuente de alimentación

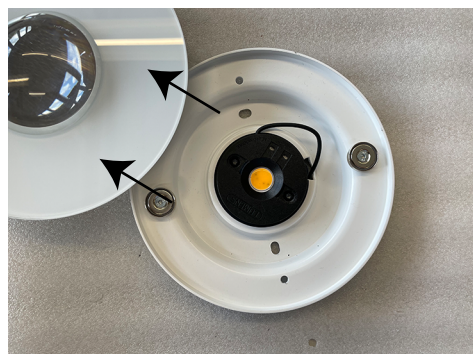


2

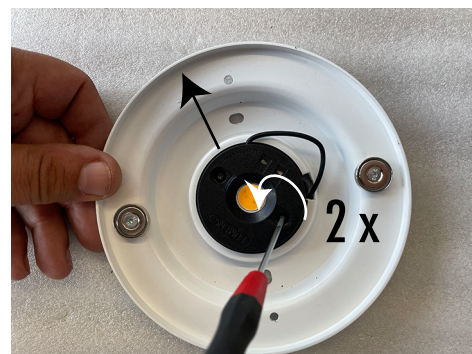


3



4

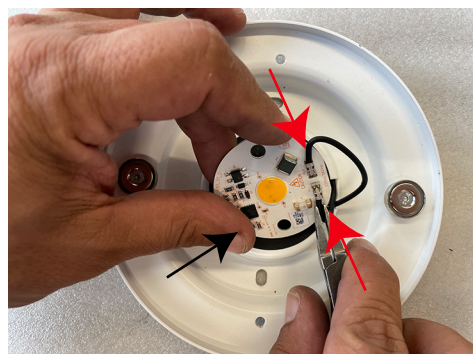


5

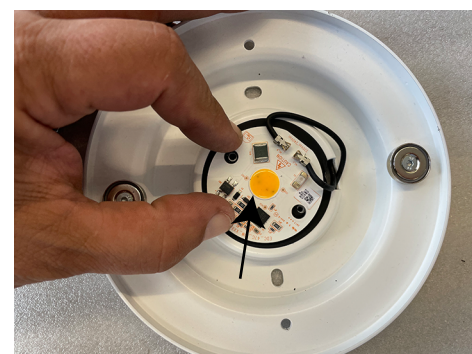

6



7

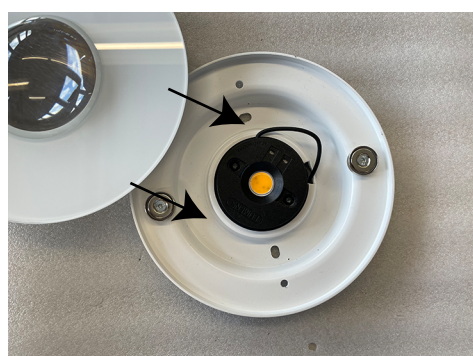

8



9

CE